

Powermite 599

MT Series SAS Electronic Valve Actuator 24 Vac or 24 Vdc, Proportional Control



SAS61.03U



SAS61.33U

Description

The Powermite 599 MT Series SAS Electronic Valve Actuator requires a 24 Vac or 24 Vdc supply and receives a 0 to 10 Vdc or a 4 to 20 mA control signal to proportionally control a valve. This actuator is designed to work with Powermite 599 MT Series terminal unit valve with a 7/32-inch (5.5 mm) stroke.

Features

- Maintenance-free with reversible motor.
- Position indicator.
- UL listed for plenum installations.
- 0 to 10V or 4 to 20 mA.
- LED status indicator.
- Auto calibration
- Position output signal 0 to 10 Vdc.
- Manual positioning knob with stroke indication allows for repositioning.
- Mechanical spring returns the valve to its normal (fail-safe) position in power-off conditions (SAS61.33U Actuator only).

Application

For use in small to medium HVAC installations with Powermite 599 Series terminal unit valves with a 7/32-inch (5.5 mm) stroke requiring a minimum of 90 pounds force (400N). They can be used in liquid and low pressure steam service applications.

Table 1. Ordering Information.

Product Numbers	Product Number	Actuator type	Actuator Prefix Code
	SAS61.03U	Non-Spring Return (Fail-in-place)	364
	SAS61.33U	Spring Return (Fail-safe)	365

Ordering Information

To order a complete valve plus actuator assembly from the factory, combine the actuator prefix code with the suffix of the valve product number. See TB 251 *Powermite 599 Series MT Series Terminal Unit Valve and Actuator Assembly Selections Technical Bulletin* (155-306P25) for selection procedures.

To order an actuator only, use the product number in Table 1.

Specifications

Power Requirements

Operating voltage	24 Vac \pm 20%, 24 Vdc, + 20%, -15%
Frequency	45 to 65 Hz
Power supply	Earth ground isolating, Class 2, 24V transformer, 100 VA max.
Power consumption - running	
SAS61.03U	5.3 VA
SAS61.33U	5.9 VA

Control Characteristics

Terminal Designation

Y	Control Signal	0 to 10 Vdc, 4 to 20 mA
	Current draw	\leq 0.1 mA for 0 to 10 Vdc control 4 to 20 mA \pm 1% for 4 to 20 mA control
U	Input impedance	>100K ohms
	Position feedback	
	Voltage	0 to 10 Vdc \pm 1%
	Load impedance	>10K Ω res.
	Current load	1 mA max.
Z	Forced control	
	Resistance	0 to 1000 Ω , stroke proportional to R
	Z connected to G	Max. stroke 100%
	Z connected to G0	Min. stroke 0%
	Voltage	Max. 24 Vac to 20%, Max 24 Vdc+20%,-15%
	Current draw	\leq 0.1 mA

Functional Operation

Running time	30 seconds
at 60 Hz	
Spring return (SAS61.33U only)	<14 seconds
Nominal stroke	7/32-inch (5.5 mm)
Nominal Force	90 lbs. (400N)
Spring return (SAS61.33U only)	Mechanical spring

Agency Approvals


UL	UL873
cUL	Certified to CSA C22.2 No. 24-93

Environmental Conditions

Ambient temperature	
Operation	23°F to 131°F (–5°C to 55°C)
Transport and storage	–13°F to 158°F (–25°C to 70°C)
Humidity	<95% rh
Max. permissible media temperature in valve	34°F to 248°F (1°C to 120°C)

Physical Characteristics

Conduit opening	Knockouts for standard 1/2-inch conduit connector
Weight	
SAS61.03U	0.9 lbs. (0.4 kg)
SAS61.33U	1.5 lbs. (0.68 kg)
Dimensions	See Figure 4 and Figure 5.

Accessory

Auxiliary Switch ASC10.51 switches on or off when a certain position is reached. The switching point can lie between 0 to 100%.

Service Kit

If the actuator is inoperative, replace the unit.

Operation

A zero voltage control signal returns the valve to its normal position.

In the event of a power failure:

- SAS61.03U is non-spring return and holds its last position.
- SAS61.33U returns the valve to its normal spring return position.

The position output 0 to 10 Vdc signal "U" produces position feedback to the controller.

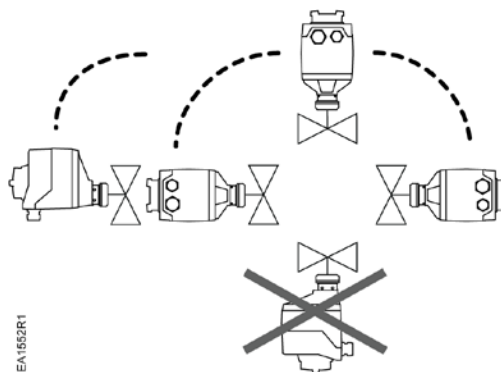
Mounting and Installation

Figure 1. Acceptable Mounting Positions.

Mount the actuator in any position *except* with the actuator lower than the valve. Figure 1 shows acceptable actuator mounting positions for water applications. The recommended mounting position of the actuator for low pressure steam applications is between 45° and horizontal.

Wiring

- All units using the same control signal must utilize the same neutral reference (G0).
- Use earth ground isolating, step-down Class 2 transformers. Do *not* use auto transformers.
- Determine supply transformer minimum rating by summing the total equipment on circuit. The maximum rating for Class 2 step-down transformers is 100 VA.
- Do *not* power more than 10 actuators with one transformer.

**WARNING:**

Housing rated for flex conduit only.

Wiring Diagrams

G0	Neutral (-)
G	Hot (+)
Y	Positioning signal for 0 to 10 Vdc/4 to 20 mA
M	Measuring neutral
U	Position feedback 0 to 10 Vdc
Z	Positioning signal forced control AC/DC ≤ 24V, 0 to 1000 Ω

Figure 2. Terminal Connections.



WARNING:
Terminal connection G is 24 Vac HOT, not ground.



CAUTION:
G0 and G must be properly wired for correct function and full life of the actuator.

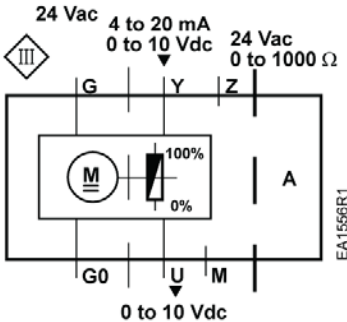


Figure 3. Wiring Diagram.

The diagram shows all possible connections. The application determines which connections are used.

Start-up

The valve body (normally open or normally closed) determines the action of the complete valve/actuator assembly.

Troubleshooting

- Check wiring for proper connections and secure attachments.
- Check for adequate power supply.

Dimensions

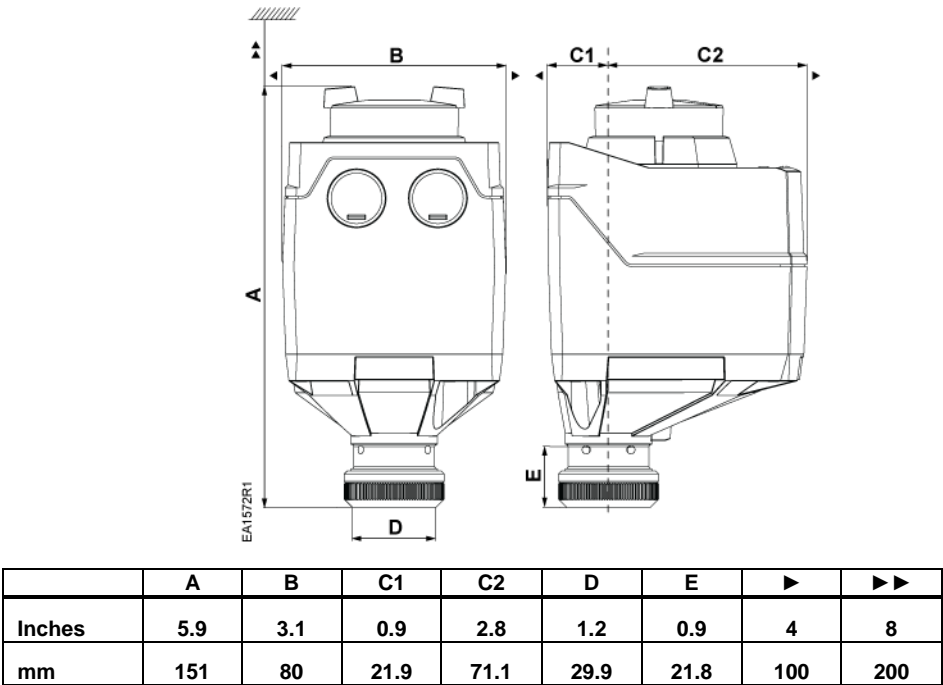


Figure 4. SAS61.03U Actuator Dimensions.

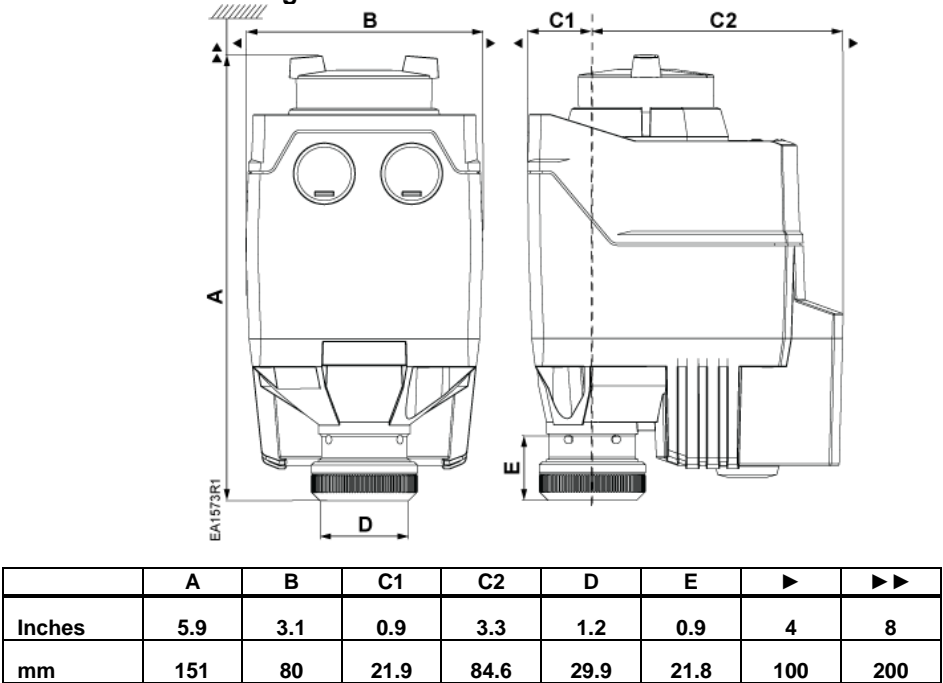


Figure 5. SAS61.33U Actuator Dimensions.

Information in this publication is based on current specifications. The company reserves the right to make changes in specifications and models as design improvements are introduced. Product or company names mentioned herein may be the trademarks of their respective owners.
© 2016 Siemens Industry, Inc.